

# CLAYTON SCHOOL (PWS 7190016) SOURCE WATER ASSESSMENT FINAL REPORT

---

February 25, 2003



**State of Idaho**  
**Department of Environmental Quality**



SOWQP

**Disclaimer:** This publication has been developed as part of an informational service for the source water assessments of public water systems in Idaho and is based on data available at the time and the professional judgement of the staff. Although reasonable efforts have been made to present accurate information, no guarantees, including expressed or implied warranties of any kind, are made with respect to this publication by the State of Idaho or any of its agencies, employees, or agents, who also assume no legal responsibility for the accuracy of presentations, comments, or other information in this publication. The assessment is subject to modification if new data is produced.

## Executive Summary

Under the Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency (EPA) to assess every source of public drinking water for its relative sensitivity to contaminants regulated by the Act. This assessment is based on a land use inventory of the designated assessment area and sensitivity factors associated with the wells and aquifer characteristics.

This report, *Source Water Assessment for Clayton School, Clayton, Idaho*, describes the public drinking water system, the boundaries of the zones of water contribution, and the associated potential contaminant sources located within these boundaries. This assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. **The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

The Clayton School (PWS #7190016) drinking water system consists of one well. The well was constructed in 1985 and is the main water supply serving the system's approximately 8 people through 1 connection.

Final susceptibility scores are derived from equally weighting system construction scores, hydrologic sensitivity scores, and potential contaminant/land use scores. Therefore, a low rating in one or two categories coupled with a higher rating in other categories results in a final rating of low, moderate, or high susceptibility. With the potential contaminants associated with most urban and heavily agricultural areas, the best score a well can get is moderate. Potential contaminants are divided into four categories, inorganic contaminants (IOCs, i.e. nitrates, arsenic), volatile organic contaminants (VOCs, i.e. petroleum products), synthetic organic contaminants (SOCs, i.e. pesticides), and microbial contaminants (i.e. bacteria). As different wells can be subject to various contamination settings, separate scores are given for each type of contaminant.

In terms of total susceptibility, the Clayton School well rated moderate for IOCs, VOCs, SOCs, and microbials. System construction rated high and hydrologic sensitivity rated moderate for the well. Land use scores were moderate for IOCs, VOCs, SOCs, and low for microbials. The largest influences upon overall scores was the amount of agricultural land within the well's delineation and the automatically high default scores due to a missing well log. If the well log had been available during this analysis, overall scores might have been lower.

There are no major issues affecting Clayton School's water. No SOCs, VOCs, or microbials have ever been detected in the tested water. The IOCs barium, fluoride, nitrate, and sodium have been detected in the well. Each of the IOCs have been detected in concentrations significantly below their maximum contaminant levels (MCLs).

This assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what ranking a source receives, protection is always important. Whether the source is currently located in a "pristine" area or an area with numerous industrial and/or agricultural land uses that require surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources. If the system should need to

expand in the future, new well sites should be located in areas with as few potential sources of contamination as possible, and the site should be reserved and protected for this specific use.

For the Clayton School, drinking water protection activities should first focus on correcting any deficiencies outlined in the sanitary survey (an inspection conducted every five years with the purpose of determining the physical condition of a water system's components and its capacity). Actions should be taken to keep a 50-foot radius circle around the wellhead clear of potential contaminants. Any contaminant spills within the delineation should be carefully monitored and dealt with. As much of the designated assessment areas are outside the direct jurisdiction of Clayton School, collaboration and partnerships with state and local agencies should be established and are critical to success.

Due to the time involved with the movement of ground water, drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term. A strong public education program should be a primary focus of any drinking water protection plan as the delineation contains some urban and residential land uses. Public education topics could include proper lawn and garden care practices, household hazardous waste disposal methods, proper care and maintenance of septic systems, and the importance of water conservation to name but a few. There are multiple resources available to help communities implement protection programs, including the Drinking Water Academy of the EPA. Drinking water protection activities for agriculture should be coordinated with the Idaho State Department of Agriculture, the Soil Conservation Commission, the local Soil and Water Conservation District, and the Natural Resources Conservation Service.

A community must incorporate a variety of strategies in order to develop a comprehensive drinking water protection plan, be they regulatory in nature (i.e. zoning, permitting) or non-regulatory in nature (i.e. good housekeeping, public education, specific best management practices). For assistance in developing protection strategies please contact the Idaho Falls Regional Office of the DEQ or the Idaho Rural Water Association.

# **SOURCE WATER ASSESSMENT FOR CLAYTON SCHOOL, CLAYTON, IDAHO**

## **Section 1. Introduction - Basis for Assessment**

The following sections contain information necessary to understand how and why this assessment was conducted. **It is important to review this information to understand what the ranking of this assessment means.** Maps showing the delineated source water assessment area and the inventory of significant potential sources of contamination identified within that area are included. The list of significant potential contaminant source categories and their rankings used to develop the assessment also is included.

### **Background**

Under the Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency (EPA) to assess every source of public drinking water for its relative susceptibility to contaminants regulated by the Safe Drinking Water Act. This assessment is based on a land use inventory of the delineated assessment area and sensitivity factors associated with the wells and aquifer characteristics.

### **Level of Accuracy and Purpose of the Assessment**

Since there are over 2,900 public water sources in Idaho, there is limited time and resources to accomplish the assessments. All assessments must be completed by May of 2003. An in-depth, site-specific investigation of each significant potential source of contamination is not possible. **Therefore, this assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

The ultimate goal of the assessment is to provide data to local communities to develop a protection strategy for their drinking water supply system. The Idaho Department of Environmental Quality recognizes that pollution prevention activities generally require less time and money to implement than treatment of a public water supply system once it has been contaminated. DEQ encourages communities to balance resource protection with economic growth and development. The decision as to the amount and types of information necessary to develop a drinking water protection program should be determined by the local community based on its own needs and limitations. Wellhead or drinking water protection is one facet of a comprehensive growth plan, and it can complement ongoing local planning efforts.

## **Section 2. Conducting the Assessment**

### **General Description of the Source Water Quality**

The Clayton School (PWS #7190016) drinking water system is located in Custer County, Idaho (Figure 1).. The system consists of one well which was constructed in 1985 and is the main water supply serving the system's approximately 8 people through 1 connection.

There are no major issues affecting Clayton School's water. No SOC's, VOC's, or microbials have ever been detected in the tested water. The IOC's barium, fluoride, nitrate, and sodium have been detected in the well. Each of the IOC's have been detected in concentrations significantly below their MCL's.

### **Defining the Zones of Contribution – Delineation**


The delineation process establishes the physical area around a well that will become the focal point of the assessment. The process includes mapping the boundaries of the zone of contribution into time-of-travel (TOT) zones (zones indicating the number of years necessary for a particle of water to reach a well) for water in the aquifer. Washington Group International (WGI) performed the delineation using a computer model approved by the EPA in determining the 3-year (Zone 1B), 6-year (Zone 2), and 10-year (Zone 3) TOT for water associated with the Snake River Plain aquifer in the vicinity of the Clayton School. The computer model used site specific data, assimilated by WGI from a variety of sources including local area well logs, and hydrogeologic reports (detailed below).

### **Hydrogeologic Conceptual Model**

Graham and Campbell (1981) identified and described 70 regional ground water systems throughout Idaho. Thirty-four of these fall within the southeastern part of the state. The "None" hydrologic province, as defined in this report, includes all the area outside of the 34 regional systems in southeast Idaho. The smaller and more localized aquifers in the "None" province typically are situated in the foothills and mountains that surround and recharge the regional ground water systems.

The mountains and valleys within the "None" hydrologic province were formed during two events separated by approximately 50 to 70 million years (Alt and Hyndman, 1989, pp. 329 and 336). The overthrust belt of the northern Rocky Mountains was formed roughly 70 to 90 million years ago through the intrusion of granitic magma and a massive eastward movement of large slabs of layered sedimentary rocks along faults that dip shallowly westward (Alt and Hyndman, 1989, p. 329). This movement caused extreme folding and fracturing of the sedimentary and granitic rocks and, in many cases, left older formations lying on top of younger ones. Later Basin and Range block faulting broke up the largely eroded Rocky Mountains into large uplifted and downthrown blocks resulting in the present day northwest trending mountains and valleys seen throughout southeast Idaho. Paleozoic and Precambrian limestone, dolomite, sandstone, shale, siltstone, and quartzite are the predominant materials forming the mountains and probably compose the bedrock underlying the valleys between Salmon, Idaho on the north side of the Snake River Plane and Franklin, Idaho near the Utah/Idaho border (Dion, 1969, p.18; Kariya et al., 1994, p. 6; Bjorklund and McGreevy, 1971, p. 12; and Parlman, 1982, p. 9).

FIGURE 1- GEOGRAPHIC LOCATION OF CLAYTON SCHOOL WELL #1, PWS 7190016

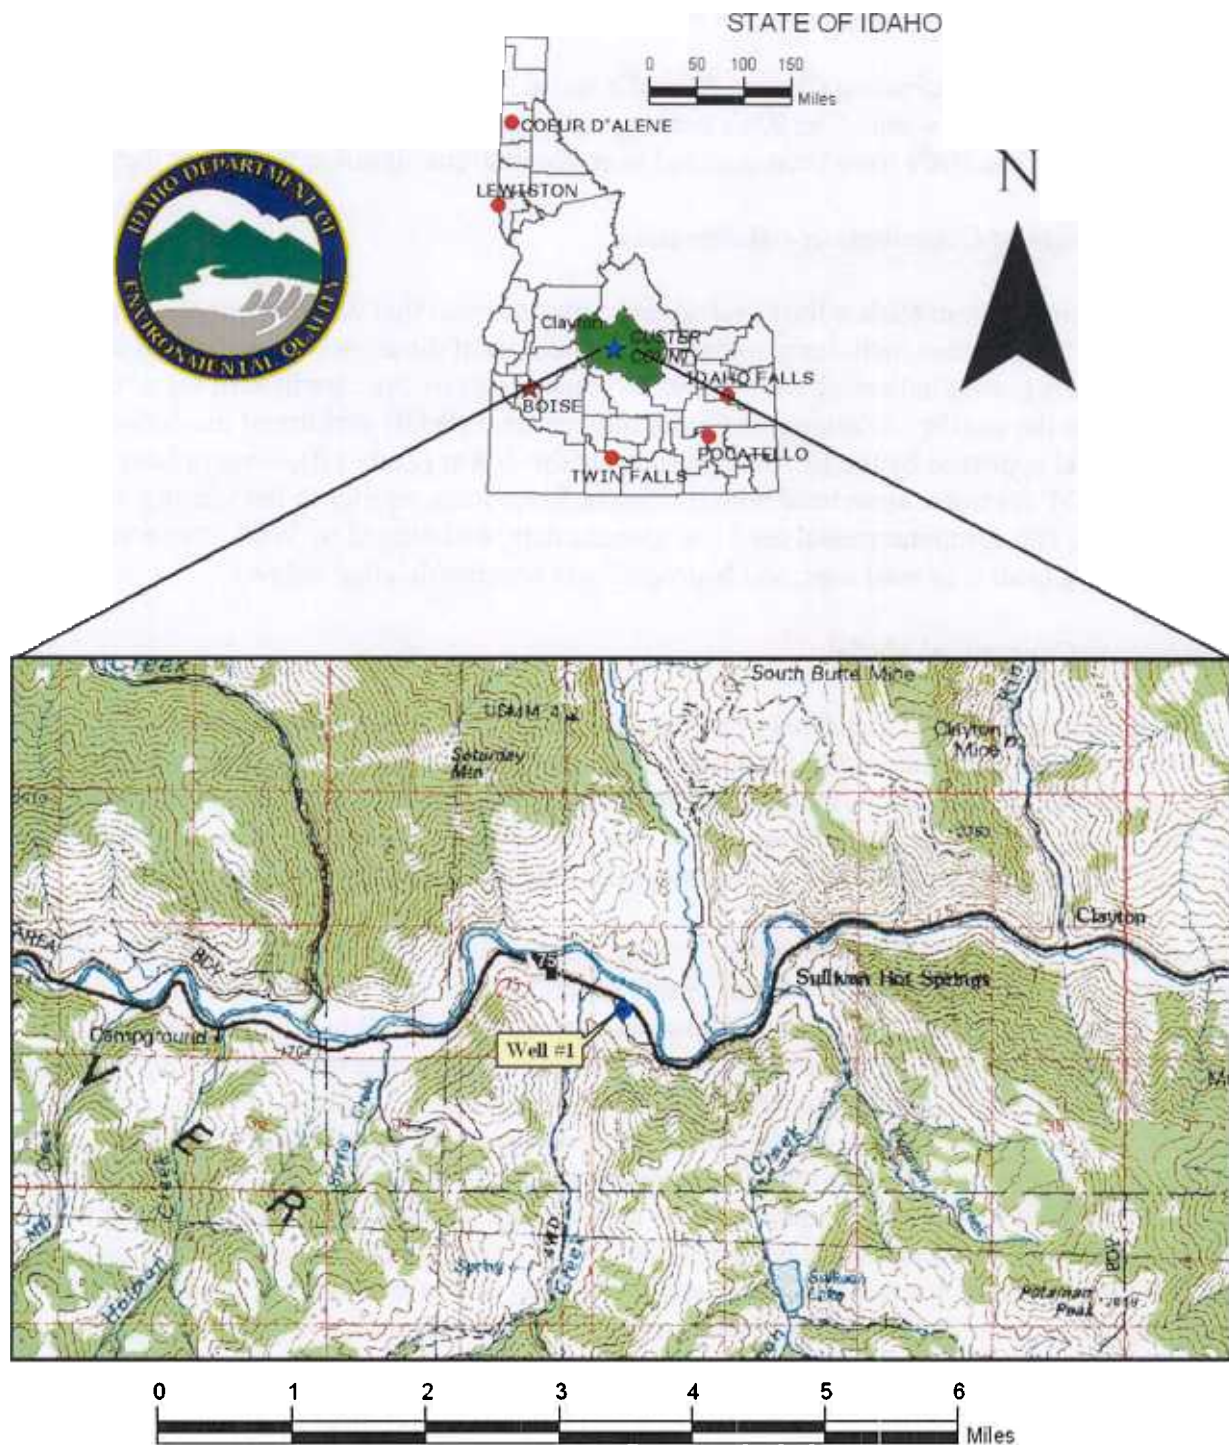



Ground water movement in the mountains is primarily through a system of solution channels, fractures and joints that commonly transmit water independently of surface topography (Bjorklund and McGreevy, 1971, p. 15; Dion, 1969, p. 18). Ralston and others (1979, pp. 128-129) state that the geologic structural features also can contribute to the development of cross-basin ground-water flow systems. Ground water entering a geologic formation tends to follow the formation because hydraulic conductivities are greater parallel to the bedding planes than across them. Synclines and anticlines provide structural avenues for groundwater flow under ridges from one valley to another.

There is little available information on the distribution of hydraulic head and the hydraulic properties of the aquifers in the "None" hydrologic province. No USGS (2001) or Idaho Statewide Monitoring Network (Neely, 2001) wells are located in the areas of concern to provide information on ground-water flow direction and hydraulic gradient or to aid in model calibration. The information that is available indicates that the hydraulic properties are quite variable, even within a specific rock type. Ralston and others (1979, p. 31), for example, present hydraulic conductivity estimates for fractured chert ranging from 2.2 to 75 ft/day. Estimates for phosphatic shale are as low as 0.07 ft/day (unfractured) and as high as 25 ft/day (fractured).

The calculated fixed-radius method (IDEQ, 1997 p. 4-9) was used to delineate capture zones for PWS wells in the "None" hydrologic province. The fixed radii for the 3-, 6-, and 10-year capture zones were calculated using equations presented by Keely and Tsang (1983) for the velocity distribution surrounding a pumping well. This method was selected because the ground-water flow systems in the mountains of southeast Idaho are typically very complex and poorly characterized. Ground-water infiltrating into folded, faulted, and fractured bedrock formations may recharge shallow localized systems with short flow paths and residence times or it may enter deeper intermediate or regional systems with longer flow paths and residence times. Unfortunately, there generally are no water level data with which to determine the flow direction and hydraulic gradient in the different aquifers. In the absence of water level data, the groundwater flow direction and hydraulic gradient may differ greatly from one flow system to another, because of the existence of structural controls and heterogeneity.

The delineated area for the Clayton School well is a circle approximately 0.15 miles in diameter. The actual data used in determining the source water assessment delineation area is available from DEQ upon request.

### **Identifying Potential Sources of Contamination**

A potential source of contamination is defined as any facility or activity that stores, uses, or produces, as a product or by-product, the contaminants regulated under the Safe Drinking Water Act and has a sufficient likelihood of releasing such contaminants at levels that could pose a concern relative to drinking water sources. The goal of the inventory process is to locate and describe those facilities, land uses, and environmental conditions that are potential sources of groundwater contamination. The locations of potential sources of contamination within the delineation areas were obtained by field surveys conducted by DEQ and from available databases.

Land use within the area surrounding the Clayton School wells is predominantly irrigated agriculture.

It is important to understand that a release may never occur from a potential source of contamination provided they are using best management practices. Many potential sources of contamination are regulated at the federal level, state level, or both to reduce the risk of release. Therefore, when a business, facility, or property is identified as a potential contaminant source, this should not be interpreted to mean that this business, facility, or property is in violation of any local, state, or federal environmental law or regulation. What it does mean is that the potential for contamination exists due to the nature of the business, industry, or operation. There are a number of methods that water systems can use to work cooperatively with potential sources of contamination, including educational visits and inspections of stored materials. Many owners of such facilities may not even be aware that they are located near a public water supply well.

### Contaminant Source Inventory Process

A two-phased contaminant inventory of the study area was conducted in May and June 2002. The first phase involved identifying and documenting potential contaminant sources within the Clayton School source water assessment area (Figure 2) through the use of computer databases and Geographic Information System (GIS) maps developed by DEQ. The second, or enhanced, phase of the contaminant inventory involved contacting the operator to identify and add any additional potential sources in the delineated areas.

The delineated source water area for the well (Figure 2, Table 1) has its potential contaminants outlined below. The only source includes Highway 93.

**Table 1. Clayton School, Well #1, Potential Contaminant Inventory**


SITE	Source Description <sup>1</sup>	TOT <sup>2</sup> ZONE	Source of Information	Potential Contaminants <sup>3</sup>
	Highway 93	6-10 YR	GIS Map	IOC, VOC, SOC

<sup>2</sup> TOT = time-of-travel (in years) for a potential contaminant to reach the wellhead

<sup>3</sup> IOC = inorganic chemical, SOC = synthetic organic chemical, VOC = volatile organic chemical



**FIGURE 2 - Clayton School Delineation Map and Potential Contaminant Source Locations**

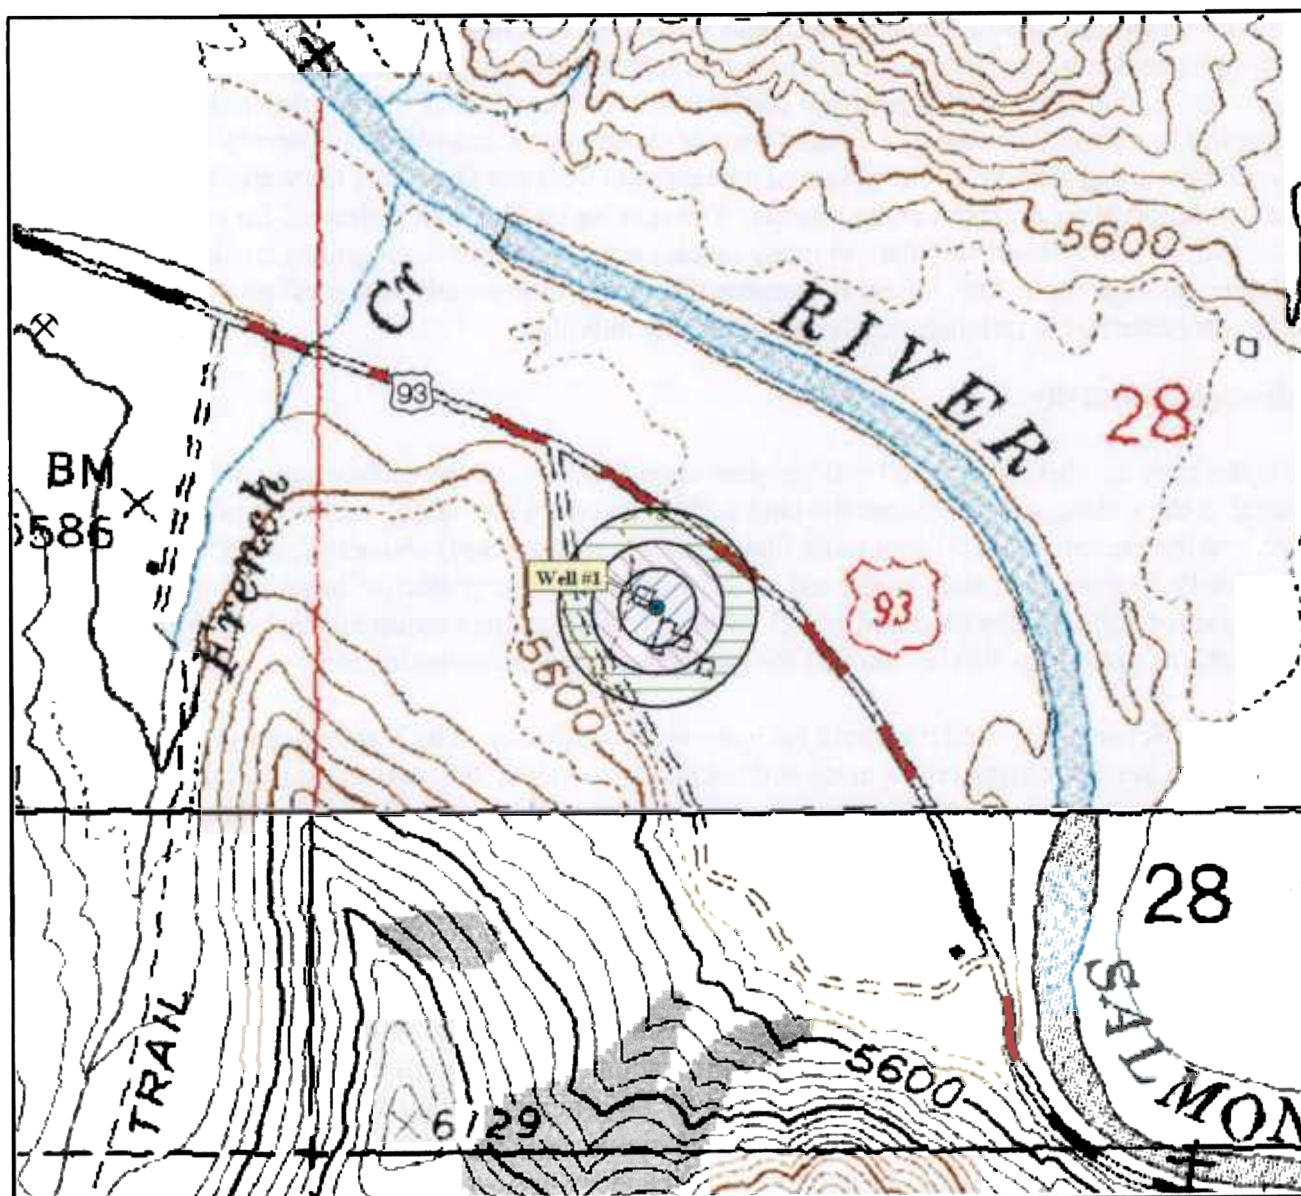

**Technical Services  
Data/GIS**  
W. Kelley 8/30/02

**PWS# 7190016  
Well #1**

## **Section 3. Susceptibility Analyses**

Each well's susceptibility to contamination was ranked as high, moderate, or low risk according to the following considerations: hydrologic characteristics, physical integrity of the well, land use characteristics, and potentially significant contaminant sources (Table 2). The susceptibility rankings are specific to a particular potential contaminant or category of contaminants. Therefore, a high susceptibility rating relative to one potential contaminant does not mean that the water system is at the same risk for all other potential contaminants. The relative ranking that is derived for each well is a qualitative, screening-level step that, in many cases, uses generalized assumptions and best professional judgement. Attachment A contains the susceptibility analysis worksheets. The following summaries describe the rationale for the susceptibility ranking.

### **Hydrologic Sensitivity**

The hydrologic sensitivity of a well is dependent upon four factors: the surface soil composition, the material in the vadose zone (between the land surface and the water table), the depth to first ground water, and the presence of a 50-foot thick fine-grained zone (aquiclude) above the producing zone of the well. Slowly draining soils such as silt and clay typically are more protective of ground water than coarse-grained soils such as sand and gravel. Similarly, fine-grained sediments in the subsurface and a water depth of more than 300 feet protect the ground water from contamination.

The Clayton School well rated moderate for hydrologic sensitivity. The Natural Resource Conservation Service characterized areas soils as poorly to moderately drained, positively affecting the score. However, because no well log was available during this analysis, the composition of the vadose zone, the water table depth, and presence of an aquiclude are unknown. If a well log had been available during this analysis, hydrologic sensitivity scores might have been lower.

### **Well Construction**

Well construction directly affects the ability of the well to protect the aquifer from contaminants. System construction scores are reduced when information shows that potential contaminants will have a more difficult time reaching the intake of the well. Lower scores imply a system is less vulnerable to contamination. For example, if the well casing and annular seal both extend into a low permeability unit, then the possibility of contamination is reduced and the system construction score goes down. If the highest production interval is more than 100 feet below the water table, then the system is considered to have better buffering capacity. If the wellhead and surface seal are maintained to standards, as outlined in sanitary surveys, then contamination down the well bore is less likely. If the well is protected from surface flooding and is outside the 100-year floodplain, then contamination from surface events is reduced.

Clayton School's well rated high for system construction. According to the 1996 Sanitary Survey, the surface seal is in compliance and the well is located outside of the 100-year floodplain, however, the wellhead is missing an adequate vent (at least 18 inches high, downturned, and screened). Because the well log was unavailable during this analysis, it is unknown if the casing and annular seal extend into low permeability units, or if the highest production comes from more than 100 feet below static water levels.

Current PWS well construction standards are more stringent than when the well was constructed. The Idaho Department of Water Resources *Well Construction Standards Rules* (1993) require all PWSs to follow DEQ standards as well. IDAPA 58.01.08.550 requires that PWSs follow the *Recommended Standards for Water Works* (1997) during construction. Some of the regulations deal with screening requirements, aquifer pump tests, use of a downturned casing vent, and thickness of casing. Table 1 of the *Recommended Standards for Water Works* (1997) lists the required steel casing thickness for various diameter wells. Eight-inch diameter wells require a casing thickness of 0.322 inches. Because it is unknown if the well's construction meets all current standards, the well was assessed an additional system construction point.

### Potential Contaminant Source and Land Use

The well rated moderate for IOCs, VOCs, SOC, and low for microbials. The high percentage of irrigated agricultural land within the delineation contributed the highest amount to the ratings. Also factoring into the scoring was Highway 93.

### Final Susceptibility Ranking

A detection above a drinking water standard MCL, any detection of a VOC or SOC, or a detection of total coliform bacteria or fecal coliform bacteria at the wellhead will automatically give a high susceptibility rating to a well despite the land use of the area because a pathway for contamination already exists. Additionally, potential contaminant sources within 50 feet of a wellhead will automatically lead to a high susceptibility rating. Hydrologic sensitivity and system construction scores are heavily weighted in the final scores. Having multiple potential contaminant sources in the 0 to 3-year time of travel zone (Zone 1B) contribute greatly to the overall ranking.

**Table 2. Summary of Clayton School Susceptibility Evaluation**

Susceptibility Scores <sup>1</sup>										
Well	Hydrologic Sensitivity	Contaminant Inventory				System Construction	Final Susceptibility Ranking			
		IOC	VOC	SOC	Microbials		IOC	VOC	SOC	Microbials
Well #1	M	M	M	M	L	H	M	M	M	M

<sup>1</sup>H = High Susceptibility, M = Moderate Susceptibility, L = Low Susceptibility,

IOC = inorganic chemical, VOC = volatile organic chemical, SOC = synthetic organic chemical

### Susceptibility Summary

In terms of total susceptibility, the Clayton School well rated moderate for IOCs, VOCs, SOC, and microbials. System construction rated high and hydrologic sensitivity rated moderate for the well. Land use scores were moderate for IOCs, VOCs, SOC, and low for microbials. The largest influences upon overall scores was the amount of agricultural land within the well's delineation and the automatically high default scores due to a missing well log. If the well log had been available during this analysis, overall scores might have been lower.

There are no major issues affecting Clayton School's water. No SOCs, VOCs, or microbials have ever been detected in the tested water. The IOCs barium, fluoride, nitrate, and sodium have been detected in the well. Each of the IOCs have been detected in concentrations significantly below their MCLs.

#### **Section 4. Options for Drinking Water Protection**

The susceptibility assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what the susceptibility ranking a source receives, protection is always important. Whether the source is currently located in a "pristine" area or an area with numerous industrial and/or agricultural land uses that require surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources.

An effective drinking water protection program is tailored to the particular local drinking water protection area. A community with a fully developed drinking water protection program will incorporate many strategies. For Clayton School, drinking water protection activities should first focus on correcting any deficiencies outlined in the sanitary survey. Actions should be taken to keep a 50-foot radius circle clear around the wellheads. Any spills within the delineation should be carefully monitored and dealt with. As much of the designated protection area is outside the direct jurisdiction Clayton School, making collaboration and partnerships with state and local agencies and industry groups are critical to the success of drinking water protection. The well should maintain sanitary standards regarding wellhead protection.

Due to the time involved with the movement of ground water, drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term. A public education program should be a primary focus of any drinking water protection plan as the delineation is near residential land uses areas. Public education topics could include proper household hazardous waste disposal methods, proper care and maintenance of septic systems, and the importance of water conservation to name but a few. There are multiple resources available to help communities implement protection programs, including the Drinking Water Academy of the EPA.

A community must incorporate a variety of strategies in order to develop a comprehensive drinking water protection plan, be they regulatory in nature (i.e. zoning, permitting) or non-regulatory in nature (i.e. good housekeeping, public education, specific best management practices). For assistance in developing protection strategies please contact the Idaho Falls Regional Office of the DEQ or the Idaho Rural Water Association.

## **Assistance**

Public water suppliers and others may call the following DEQ offices with questions about this assessment and to request assistance with developing and implementing a local protection plan. In addition, draft protection plans may be submitted to the DEQ office for preliminary review and comments.

Idaho Falls Regional DEQ Office      (208) 528-2650

State DEQ Office                              (208) 373-0502

Website: <http://www.deq.state.id.us>

Water suppliers serving fewer than 10,000 persons may contact Melinda Harper ([mlharper@idahoruralwater.com](mailto:mlharper@idahoruralwater.com)), Idaho Rural Water Association, at 1-208-343-7001 for assistance with drinking water protection (formerly wellhead protection) strategies.

## POTENTIAL CONTAMINANT INVENTORY

### LIST OF ACRONYMS AND DEFINITIONS

**AST (Aboveground Storage Tanks)** – Sites with aboveground storage tanks.

**Business Mailing List** – This list contains potential contaminant sites identified through a yellow pages database search of standard industry codes (SIC).

**CERCLIS** – This includes sites considered for listing under the **Comprehensive Environmental Response Compensation and Liability Act (CERCLA)**. CERCLA, more commonly known as “Superfund” is designed to clean up hazardous waste sites that are on the national priority list (NPL).

**Cyanide Site** – DEQ permitted and known historical sites/facilities using cyanide.

**Dairy** – Sites included in the primary contaminant source inventory represent those facilities regulated by Idaho State Department of Agriculture (ISDA) and may range from a few head to several thousand head of milking cows.

**Deep Injection Well** – Injection wells regulated under the Idaho Department of Water Resources generally for the disposal of stormwater runoff or agricultural field drainage.

**Enhanced Inventory** – Enhanced inventory locations are potential contaminant source sites added by the water system. These can include new sites not captured during the primary contaminant inventory, or corrected locations for sites not properly located during the primary contaminant inventory. Enhanced inventory sites can also include miscellaneous sites added by the Idaho Department of Environmental Quality (DEQ) during the primary contaminant inventory.

**Floodplain** – This is a coverage of the 100year floodplains.

**Group 1 Sites** – These are sites that show elevated levels of contaminants and are not within the priority one areas.

**Inorganic Priority Area** – Priority one areas where greater than 25% of the wells/springs show constituents higher than primary standards or other health standards.

**Landfill** – Areas of open and closed municipal and non-municipal landfills.

**LUST (Leaking Underground Storage Tank)** – Potential contaminant source sites associated with leaking underground storage tanks as regulated under RCRA.

**Mines and Quarries** – Mines and quarries permitted through the Idaho Department of Lands.)

**Nitrate Priority Area** – Area where greater than 25% of wells/springs show nitrate values above 5mg/l.

**NPDES (National Pollutant Discharge Elimination System)** – Sites with NPDES permits. The Clean Water Act requires that any discharge of a pollutant to waters of the United States from a point source must be authorized by an NPDES permit.

**Organic Priority Areas** – These are any areas where greater than 25 % of wells/springs show levels greater than 1% of the primary standard or other health standards.

**Recharge Point** – This includes active, proposed, and possible recharge sites on the Snake River Plain.

**RICRIS** – Site regulated under **Resource Conservation Recovery Act (RCRA)**. RCRA is commonly associated with the cradle to grave management approach for generation, storage, and disposal of hazardous wastes.

**SARA Tier II (Superfund Amendments and Reauthorization Act Tier II Facilities)** – These sites store certain types and amounts of hazardous materials and must be identified under the Community Right to Know Act.

**Toxic Release Inventory (TRI)** – The toxic release inventory list was developed as part of the Emergency Planning and Community Right to Know (Community Right to Know) Act passed in 1986. The Community Right to Know Act requires the reporting of any release of a chemical found on the TRI list.

**UST (Underground Storage Tank)** – Potential contaminant source sites associated with underground storage tanks regulated as regulated under RCRA.

**Wastewater Land Applications Sites** – These are areas where the land application of municipal or industrial wastewater is permitted by DEQ.

**Wellheads** – These are drinking water well locations regulated under the Safe Drinking Water Act. They are not treated as potential contaminant sources.

**NOTE:** Many of the potential contaminant sources were located using a geocoding program where mailing addresses are used to locate a facility. Field verification of potential contaminant sources is an important element of an enhanced inventory.

Where possible, a list of potential contaminant sites unable to be located with geocoding will be provided to water systems to determine if the potential contaminant sources are located within the source water assessment area.

## References Cited

- Alt, D. D., and D.W. Hyndman, 1989, Roadside Geology of Idaho, Mountain Press Publishing Company, Missoula, Montana, 394 p.
- Bjorklund, L.J., and L.J. McGreevy, 1971, Ground-Water Resources of Cache Valley, Utah and Idaho, State of Utah Department of Natural Resources Technical Publication No. 36, 72 p.
- Dion, N.P., 1969, Hydrologic Reconnaissance of the Bear River in Southeastern Idaho, U.S. Geological Survey and Idaho Department of Reclamation, Water Information Bulletin No. 13, 66 p.
- District Seven Health Department, 1996. Sanitary Survey Report for Clayton School.
- Donato, M.M., 1998, Surface-Water/Ground-Water Relations in the Lemhi River Basin, East Central Idaho, United States Geological Survey, Water-Resources Investigations Report 98-4185, 20 p.
- Graham, W.G., and L.J. Campbell, 1981, Groundwater Resources of Idaho, Idaho Department of Water Resources, 100 p.
- Great Lakes-Upper Mississippi River Board of State and Provincial Public Health and Environmental Managers, 1997. "Recommended Standards for Water Works."
- Idaho Department of Environmental Quality, 1997. Design Standards for Public Drinking Water Systems. IDAPA 58.01.08.550.01.
- Idaho Department of Water Resources, 1993. Administrative Rules of the Idaho Water Resource Board: Well Construction Standards Rules. IDAPA 37.03.09.
- Idaho Division of Environmental Quality, 1999, Idaho Source Water Assessment Plan, October, 39 p.
- Idaho Division of Environmental Quality, 1997, Idaho Wellhead Protection Plan, Idaho Wellhead Protection Work Group, February.
- Kariya, K.A., D.M. Roark, and K.M. Hanson, 1994, Hydrology of Cache County, Utah, and Adjacent Parts of Idaho, with Emphasis on Simulation of Ground-Water Flow, State of Utah Department of Natural Resources Division of Water Resources Division of Water Rights, 120 p.
- Keely, J.F. and C.F. Tsang, 1983, Velocity Plots and Capture Zones of Pumping Centers for Ground-Water Investigations, Ground Water, vol. 21, no. 6, pp. 701-714.
- Neely, K.W., 2001, Statewide Monitoring Network, Microsoft Access, Idaho Department of Water Resources.
- Parilman, D.J., 1982, Gound-Water Quality in East-Central Idaho Valleys, U.S. Geological Survey, Open File Report 81-1011.
- Ralston, D.R., and E.W. Trihey, 1975, Distribution of Precipitation in Little Long Valley and Dry Valley Caribou County, Idaho, Idaho Bureau of Mines and Geology, Moscow, Idaho, 13 p.



Ralston, D.R., T.D. Brooks, M.R. Cannon, T.F. Corbet, Jr, H. Singh, G.V. Winter and C.M. Wai, 1979, Interaction of Mining and Water Resource Systems in the Idaho Phosphate Field, Research Technical Completion Report, Idaho Resources Research Institute, University of Idaho, 214 p.

Attachment A

Clayton School  
Susceptibility Analysis  
Worksheet

The final scores for the susceptibility analysis were determined using the following formulas:

- 1) VOC/SOC/IOC Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.2)
- 2) Microbial Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.375)

Final Susceptibility Scoring:

Low Susceptibility

6 - 12 Moderate Susceptibility

High Susceptibility

## 1. System Construction

## SCORE

Drill Date	01/01/1985	
Driller Log Available	NO	
Sanitary Survey (if yes, indicate date of last survey)	YES	1996
Well meets IDWR construction standards	NO	1
Wellhead and surface seal maintained	NO	1
Casing and annular seal extend to low permeability unit	NO	2
Highest production 100 feet below static water level	NO	1
Well located outside the 100 year flood plain	YES	0

Total System Construction Score 5

## 2. Hydrologic Sensitivity

Soils are poorly to moderately drained	YES	0
Vadose zone composed of gravel, fractured rock or unknown	YES	1
Depth to first water > 300 feet	NO	1
Aquitard present with > 50 feet cumulative thickness	NO	2

Total Hydrologic Score 4

## 3. Potential Contaminant / Land Use - ZONE 1A

IOC Score VOC Score SOC Score Microbial Score

Land Use Zone 1A	IRRIGATED CROPLAND	2	2	2	2
Farm chemical use high	NO	0	0	0	
IOC, VOC, SOC, or Microbial sources in Zone 1A	NO	NO	NO	NO	NO
Total Potential Contaminant Source/Land Use Score - Zone 1A		2	2	2	2

## Potential Contaminant / Land Use - ZONE 1B

Contaminant sources present (Number of Sources)	YES	0	0	0	0
(Score = # Sources X 2 ) 8 Points Maximum		0	0	0	0
Sources of Class II or III leacheable contaminants or	YES	4	0	0	
4 Points Maximum		4	0	0	
Zone 1B contains or intercepts a Group 1 Area	NO	0	0	0	0
Land use Zone 1B Greater Than 50% Irrigated Agricultural Land		4	4	4	4

Total Potential Contaminant Source / Land Use Score - Zone 1B 8 4 4 4

## Potential Contaminant / Land Use - ZONE II

Contaminant Sources Present	NO	0	0	0	
Sources of Class II or III leacheable contaminants or	YES	1	0	0	
Land Use Zone II Greater Than 50% Irrigated Agricultural Land		2	2	2	

Potential Contaminant Source / Land Use Score - Zone II 3 2 2 0

## Potential Contaminant / Land Use - ZONE III

Contaminant Source Present	YES	1	1	1	
Sources of Class II or III leacheable contaminants or	YES	1	1	1	
Is there irrigated agricultural lands that occupy > 50% of	YES	1	1	1	

Total Potential Contaminant Source / Land Use Score - Zone III 3 3 3 0

Cumulative Potential Contaminant / Land Use Score 16 11 11 6

## 4. Final Susceptibility Source Score

12 11 11 11

## 5. Final Well Ranking

Moderate Moderate Moderate Moderate